


- NOTES:-
1. BENCHING SHALL BE CARRIED OUT ON EMBANKMENT FOUNDATIONS WHERE THE SLOPE OF EXISTING GROUND EXCEED 1(V):5(H).
  2. BENCH DIMENSION SHALL BE AS SPECIFIED IN APPENDIX 6/3 AND SHALL NOT RESULT IN A SLOPE ANGLE STEEPER THAN 1(V):2.5(H) MEASURED FROM THE TOE TO THE CREST OF THE SLOPE.

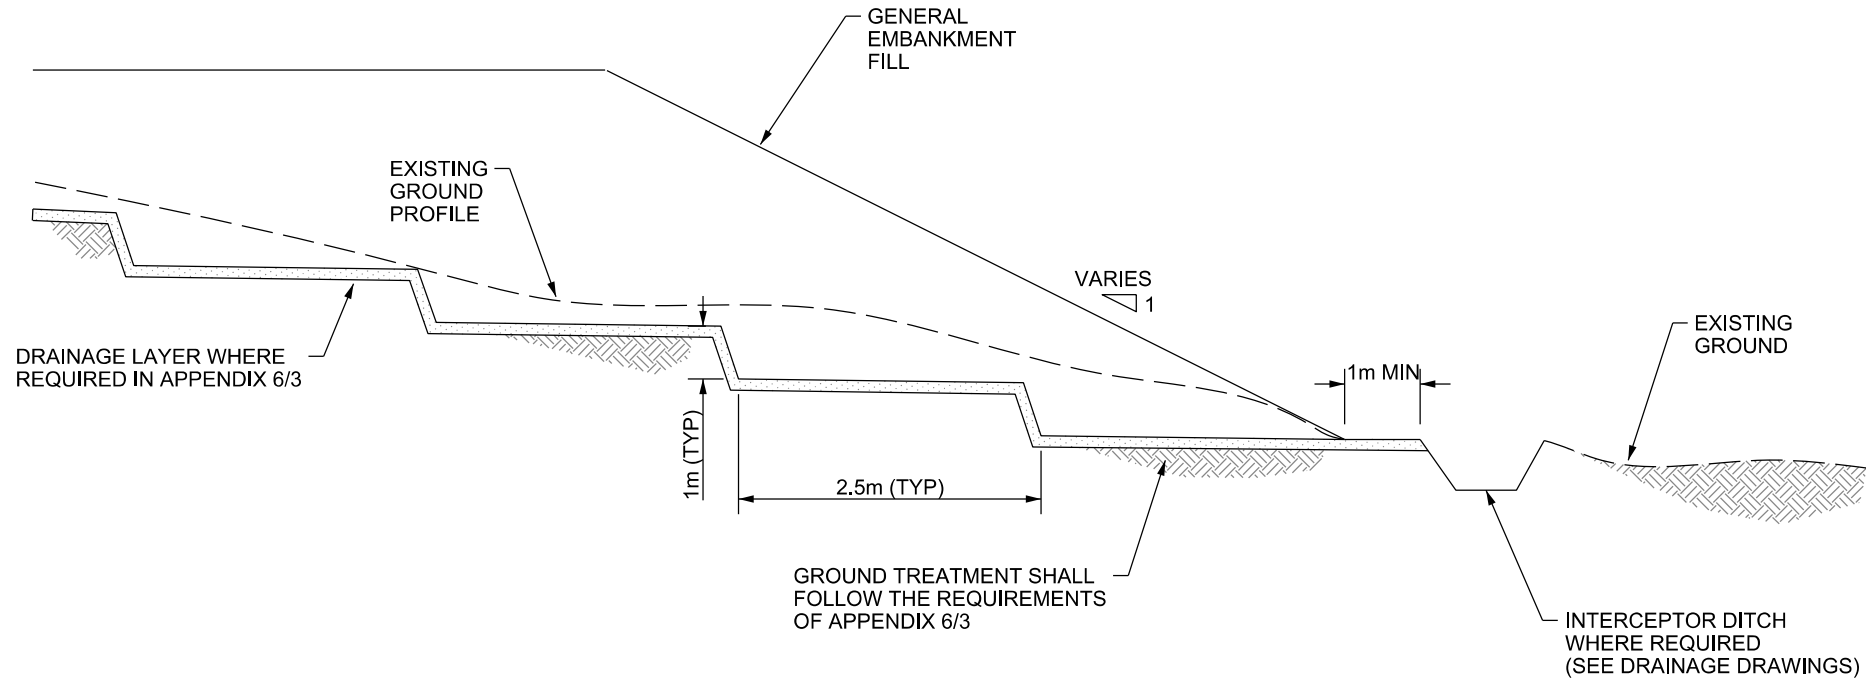

PUBLICATION TITLE  
EARTHWORKS  
BENCHING FOR EMBANKMENT ON SLOPING GROUND

STREAM	ACTIVITY	HISTORICAL REFERENCE	DOCUMENTATION SET	PUBLICATION DATE	PUBLICATION NUMBER		
					ACTIVITY	STREAM	DRAWING NUMBER
STANDARD CONSTRUCTION DETAILS (SCD)		RCD/600/5	STANDARDS	MARCH 2013	CC	SCD	00605