



**SECTION A-A**

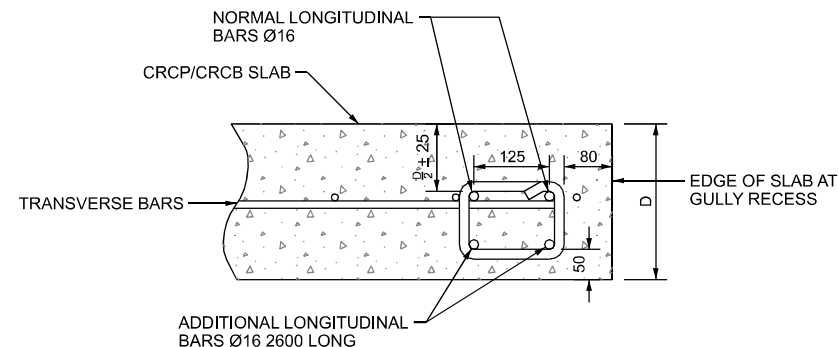

**LONGITUDINAL REINFORCEMENT  
ADJACENT TO OPENING**

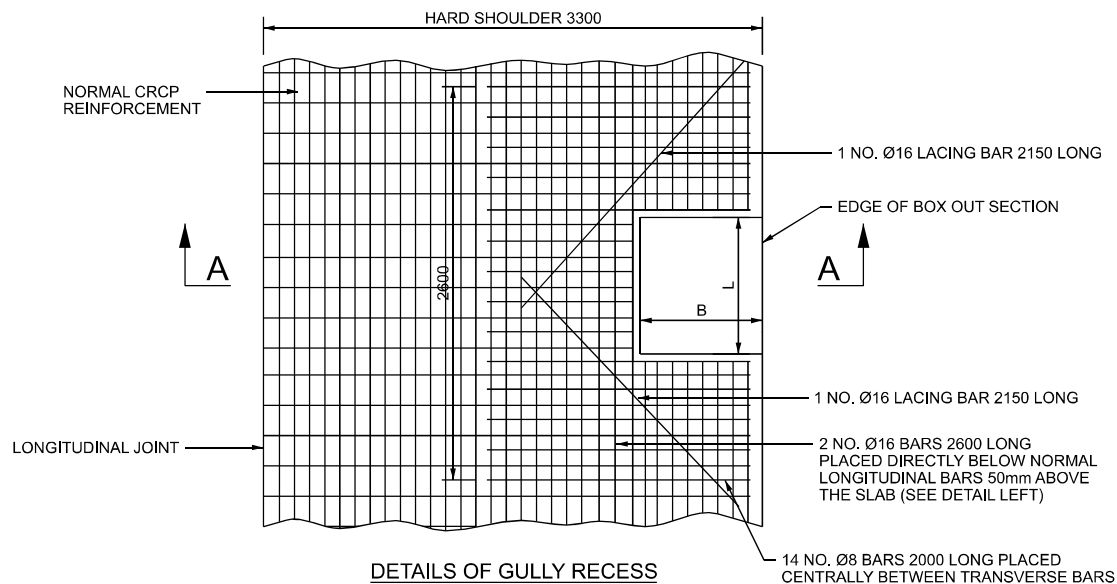

**DETAILS OF GULLY RECESS  
& CRCP REINFORCEMENT**

- NOTE :-
1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.
  2. THE OVERALL DIMENSIONS OF THE OPENING MAY VARY IN ACCORDANCE WITH THE TYPE OF GULLY GRATING USED.
  3. CONCRETE SURROUND TO BE STRENGTH CLASS C32/40.
  4. NORMAL TRANSVERSE REINFORCEMENT NEAR OPENING TO BE STRENGTHENED BY ADDITIONAL Ø8 BARS PLACED CENTRALLY BETWEEN THE TRANSVERSE BARS.
  5. REINFORCEMENT SHALL CONFORM TO CC-SPW-01000.
  6. THE Ø12 STIRRUP SHALL BE CUT AND BENT TO SUCH DIMENSION AS ALLOW IT TO BE LOCATED CENTRALLY WITHIN THE SURROUND. 450 OVERLAP SHALL BE PROVIDED IN CLOSING THE STIRRUP.
  7. FOR GULLY DETAILS SEE 500 SERIES DRAWINGS.