



ELEVATION

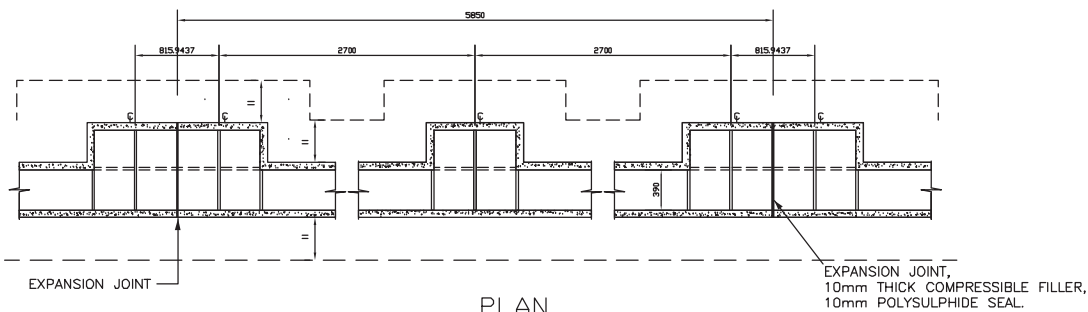

PLAN

WALL HT, (H) (mm)	X (mm)	Y (mm)	PIER CTRS. (mm)
UP TO 1200	700	225	NO PIERS
1200 TO 1800	700	225	2700
1800 TO 2500	800	250	2700

FINISH TYPE	
1	FAIRFACED
2	ROUGHCAST
3	NAPPED PLASTER
4	TYROLENE

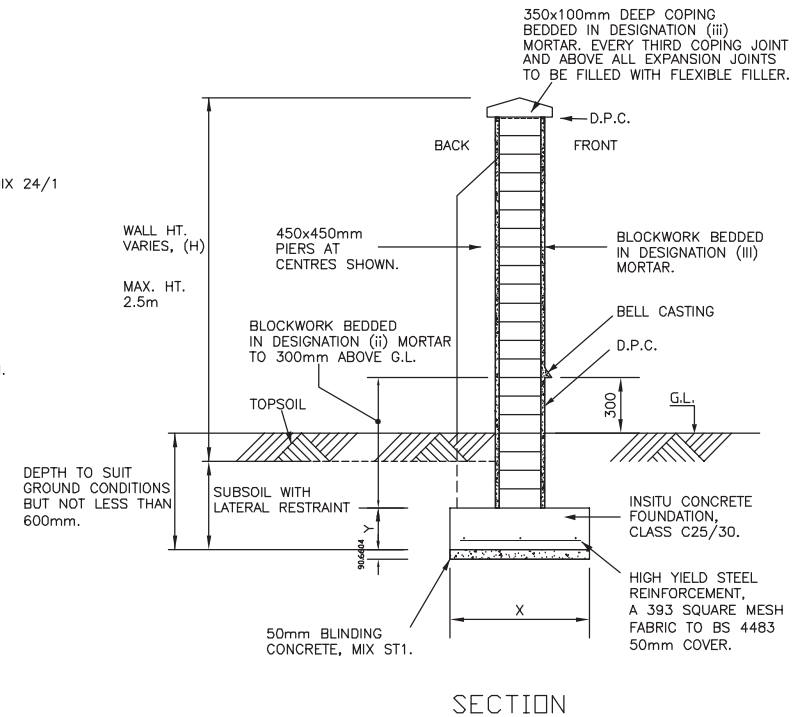

- NOTES: 1. THIS RCD IS ONLY TO BE USED IN ASSOCIATION WITH A UNIQUE STRUCTURAL DESIGN CARRIED OUT FOR THE WALLS ON A PROJECT IN ACCORDANCE WITH RELEVANT DESIGN CODES FOR BLOCKWORK, MASONRY AND LOADING.
2. BLOCKS TO COMPLY WITH I.S. E.N. 771-3.
MORTAR TO COMPLY WITH I.S. E.N. 998.
MASONRY TO COMPLY WITH I.S. E.N. 1996
FULL ADHESION OF BLOCKWORK TO MORTAR AT ALL INTERFACES.
3. RENDERED FINISHES TO BE IN ACCORDANCE WITH BS 5262 CODE OF PRACTICE FOR EXTERNAL RENDERINGS.
4. PIERS AT ENDS AND CHANGES OF DIRECTION.
ENDS OF WALLS TO RETURN BY H/3.
5. MINIMUM ALLOWABLE BEARING CAPACITY OF FORMATION 1S
25 kN/m² (UNIFORMLY DISTRIBUTED) OR
50 kN/m² (TRIANGULARLY DISTRIBUTED).

TII PUBLICATION NUMBER: CC-SCD-02401