



ELEVATION

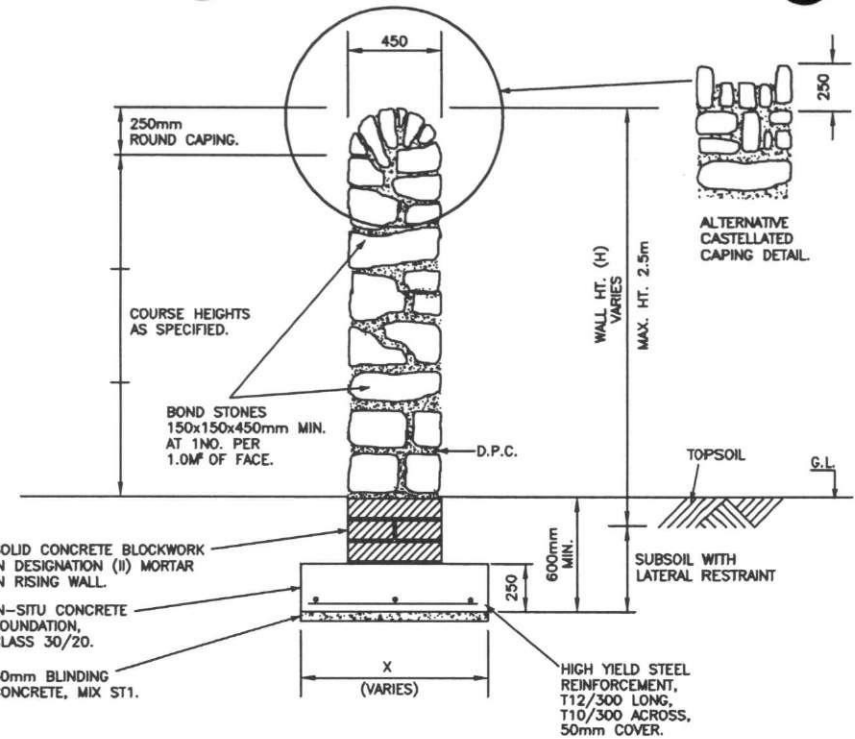

SECTION A-A

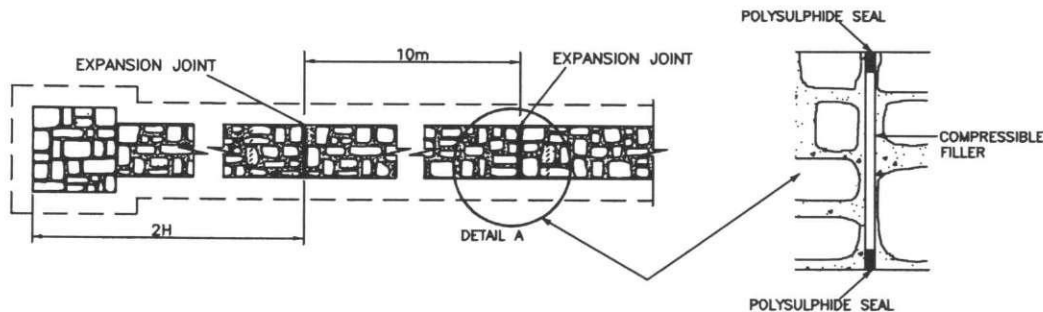

PLAN

DETAIL A

WALL HT. (H) (mm)	X (mm)
UP TO 1200	800
1200 TO 2000	1000
2000 TO 2500	1200

NOTES

1. THIS RCD IS ONLY TO BE USED IN ASSOCIATION WITH A UNIQUE STRUCTURAL DESIGN CARRIED OUT FOR THE WALLS ON A PROJECT IN ACCORDANCE WITH RELEVANT DESIGN CODES FOR BLOCKWORK, MASONRY AND LOADING.
2. MASONRY WALLS TO B.S. 5390 PLUS AMENDMENTS. FULL ADHESION OF STONWORK TO MORTAR AT ALL INTERFACES.
3. MINIMUM ALLOWABLE BEARING CAPACITY OF FORMATION IS 25 kN/m² (UNIFORMLY DISTRIBUTED) OR 50 kN/m² (TRIANGULARLY DISTRIBUTED).
4. MOVEMENT JOINTS AT 10M CENTRES (12mm COMPRESSIBLE FILLER AND 12mm POLYSULPHIDE SEAL).