




PLAN

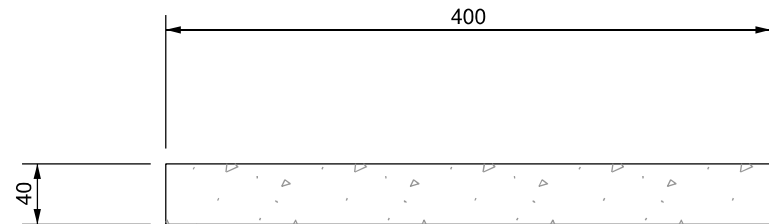

ELEVATION

MARKER SLAB, REINFORCED WITH
 100x100 Sq MESH 5mm Ø. SLAB
 THICKNESS IS 40mm, GRADE C25/30
 CONCRETE.
 REINFORCING BARS SHALL BE 20mm
 IN FROM EDGE OF CONCRETE SLAB.

		PUBLICATION TITLE WATERMAIN SERVICES MARKER SLAB								
	STREAM STANDARD CONSTRUCTION DETAILS (SCD)	HISTORICAL REFERENCE <input type="text" value="RCD/2700/52"/>	DOCUMENTATION SET <input type="text" value="STANDARD"/>	PUBLICATION DATE <input type="text" value="MARCH 2011"/>	PUBLICATION NUMBER <table border="1"> <tr> <td>ACTIVITY</td> <td>STREAM</td> <td>DRAWING NUMBER</td> </tr> <tr> <td><input type="text" value="CC"/></td> <td><input type="text" value="SCD"/></td> <td><input type="text" value="02752"/></td> </tr> </table>	ACTIVITY	STREAM	DRAWING NUMBER	<input type="text" value="CC"/>	<input type="text" value="SCD"/>
ACTIVITY	STREAM	DRAWING NUMBER								
<input type="text" value="CC"/>	<input type="text" value="SCD"/>	<input type="text" value="02752"/>								