



ELEVATION

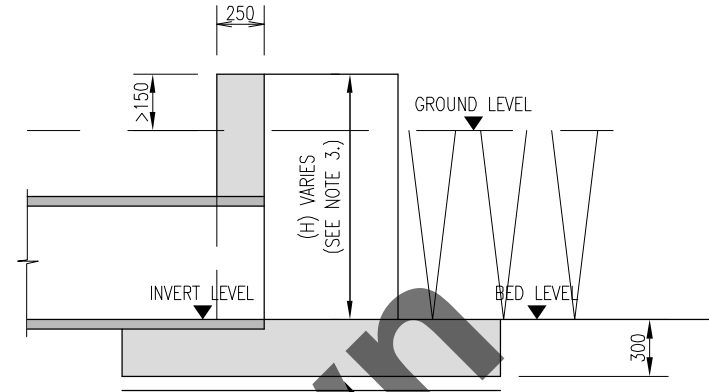

SECTION A-A

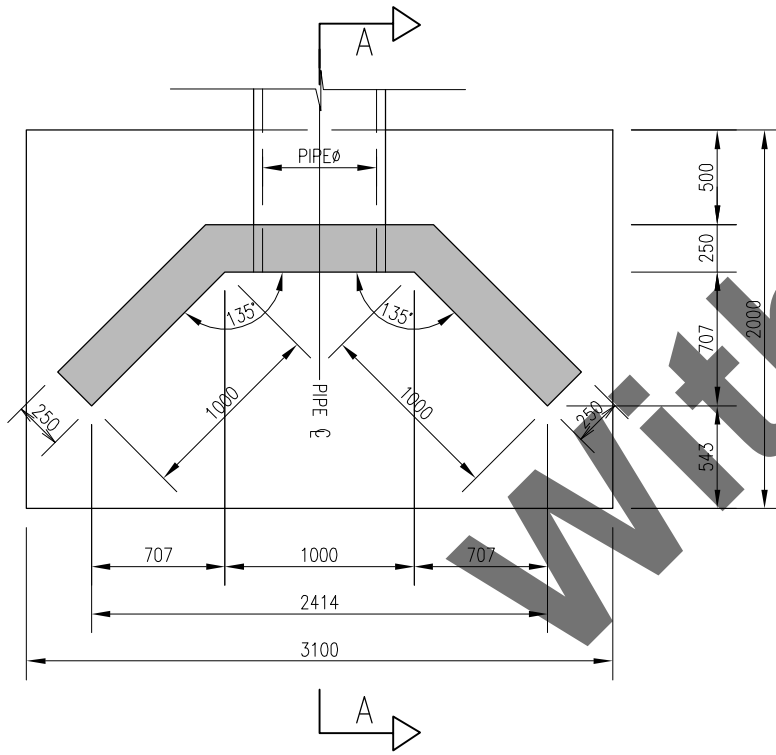

PLAN

NOTES :

1. ALL DIMENSIONS ARE MILLIMETRES EXCEPT WHERE STATED.
2. THIS RCD IS ONLY TO BE USED IN ASSOCIATION WITH A UNIQUE STRUCTURAL DESIGN CARRIED OUT FOR THE HEADWALLS ON A PROJECT IN ACCORDANCE WITH RELEVANT DESIGN CODES AND SITE GROUND CONDITIONS.
3. ALL EXPOSED CONCRETE SURFACES FROM 100mm BELOW GROUND LEVEL TO BE CLASS F3 FINISH. ALL OTHER CONCRETE SURFACES TO BE CLASS F1 FINISH UNLESS OTHERWISE SPECIFIED.
4. REFER TO DRAINAGE LONGITUDINAL SECTIONS AND/OR DRAINAGE SCHEDULES FOR PIPE DIAMETER SIZES, INVERT LEVELS AND HEADWALL HEIGHTS. MAXIMUM PIPE DIAMETER 300mm AND MAXIMUM HEADWALL HEIGHT (H) 2.3m.
5. HEADWALL WINGWALLS TO BE SLOPED WHERE APPROPRIATE AS SHOWN ON RCD/500/24.
6. MAXIMUM PIPE SIZE FOR SMALL HEADWALL SHALL NOT EXCEED 300mm INTERNAL DIAMETER.
7. RENDERED CONCRETE BLOCKWORK MAY BE USED AS AN ALTERNATIVE TO IN-SITU CONCRETE PROVIDING THE HEADWALL COMPLIES WITH IS EN 12676 AND HAS AN ACCIDENT SEVERITY INDEX <1.

75mm ST2 CONCRETE BLINDING

NOT TO SCALE

P3	01/09
P2	10/07
P1	03/00
Issue	Date